


1. WATER TO OBTAIN OPTIMUM MOISTURE CONTENT AS DETERMINED BY COMPACTION TESTING PROCTOR.
2. RESTORE SHOULDERS WITH 6" OF 5/8" MINUS CRUSHED ROCK IF DISTURBED.
3. RESTORE DITCHES DISTURBED DURING CONSTRUCTION TO ORIGINAL CONDITION.
4. PLACE A TEMPORARY PATCH OVER TRENCH CUTS AT THE END OF EACH WORKING DAY SO THAT TRAFFIC IS NOT AFFECTED. TEMPORARY PATCHING MATERIAL SHALL BE 5/8" MINUS CRUSHED ROCK. COLD MIX MAY BE REQUIRED BY THE COUNTY OR CITY AS A TEMPORARY PATCH IN SOME AREAS.
5. ALL TRENCHING TO BE DONE IN ACCORDANCE WITH OSHA AND WISHA STANDARDS.
6. CROSSINGS OF INTERSECTIONS SHALL BE RESTORED BY THE END OF THE DAY EITHER WITH PERMANENT PATCH OR TEMPORARY COLD MIX.
7. NO TRENCH IN PAVED AREAS SHALL BE LEFT UNPAVED FOR MORE THAN 12 CALENDAR DAYS OR BY THE SECOND FRIDAY, WHICHEVER COMES FIRST.
8. POLY PIPE FOR WATER SERVICES, AIR VALVES, ETC. SHALL BE BEDDED IN SAND A MINIMUM OF 6" ABOVE AND BELOW THE PIPE.
9. CITY OR COUNTY RESTORATION STANDARDS SHALL GOVERN IF MORE STRINGENT THAN SHOWN HERE.
10. INSTALL MAINS TO WITHIN 6-INCHES HORIZONTAL AND 2-INCHES VERTICAL OF THE APPROVED PLAN ALIGNMENT. VARIATIONS MUST BE APPROVED BY THE DISTRICT.



IF 18" VERTICAL CLEARANCE IS AVAILABLE ABOVE PARALLEL SEWER/IRRIG, SEPARATION MAY BE REDUCED TO 5 FT HORIZONTAL, WALL TO WALL, ONLY IF APPROVED BY THE DISTRICT. D.O.H. *WATER SYSTEM DESIGN MANUAL* SECTION 8.4 AND D.O.E. *CRITERIA FOR SEWAGE WORKS DESIGN* SECTION C1-9 SHALL BE ADHERED TO FOR CLEARANCES AND FOR MITIGATION METHODS.

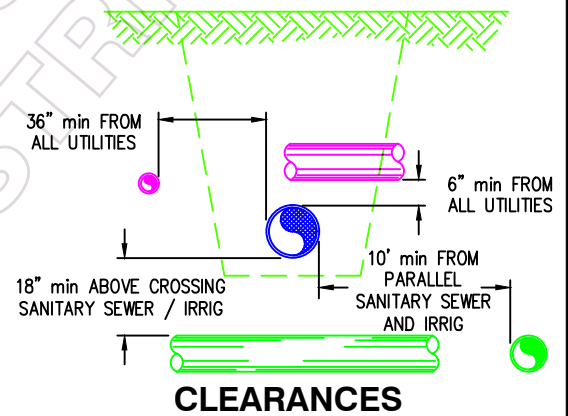