




**PROFILE**

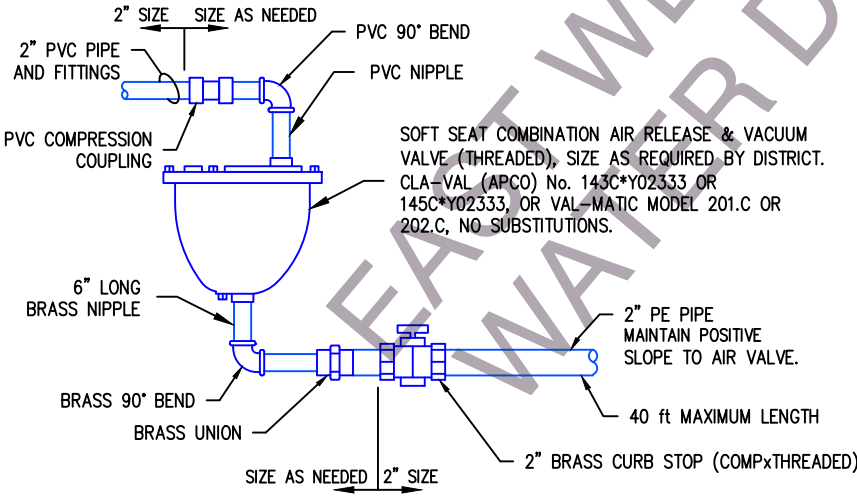

**ENLARGEMENT**

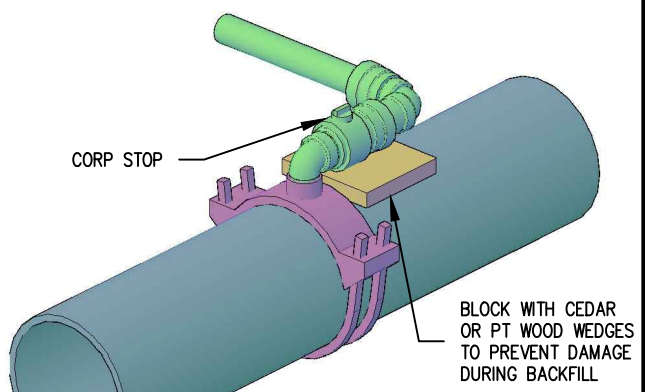

**TAP SWING JOINT**

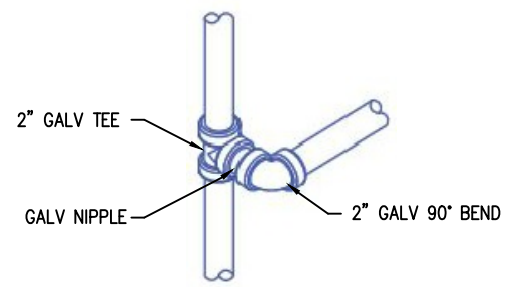

**VENT SWING JOINT**

1. AIR VALVE ASSEMBLIES SHALL BE INSTALLED AT EVERY HIGH POINT.
2. COMBINATION AIR RELEASE AND VACUUM VALVE SHALL BE A 1" SIZE FOR 6" OR 8" MAINS WHEN SPACED AT 1,500' MAX. ALL OTHER INSTALLATIONS SHALL BE 2" SIZE.
3. FOR 1" COMBINATION VALVE, INSTALL 2"x1" BRASS REDUCER BETWEEN CURB STOP AND UNION.
4. SEE DETAIL W-29 FOR VAULT INSTALLATION REQUIREMENTS.
5. ALL METAL FITTINGS TO BE DOMESTIC MADE. ALL PVC PIPE & FITTINGS TO BE SCHEDULE 40 MINIMUM.



**East Wenatchee Water District**  
WATER SYSTEM STANDARD DETAIL

COPYRIGHT 2025 EAST WENATCHEE WATER DISTRICT. MAY BE REPRODUCED UNMODIFIED FOR DISTRICT PROJECTS. OTHER REPRODUCTION OR USE WITHOUT THE DISTRICT'S WRITTEN CONSENT IS PROHIBITED.

**COMBINATION AIR VALVE ASSEMBLY**

FILENAME: EWD TW2  
REVISED: MAR 30, 2023

DRAWING No. W-10  
SHEET No. 13