
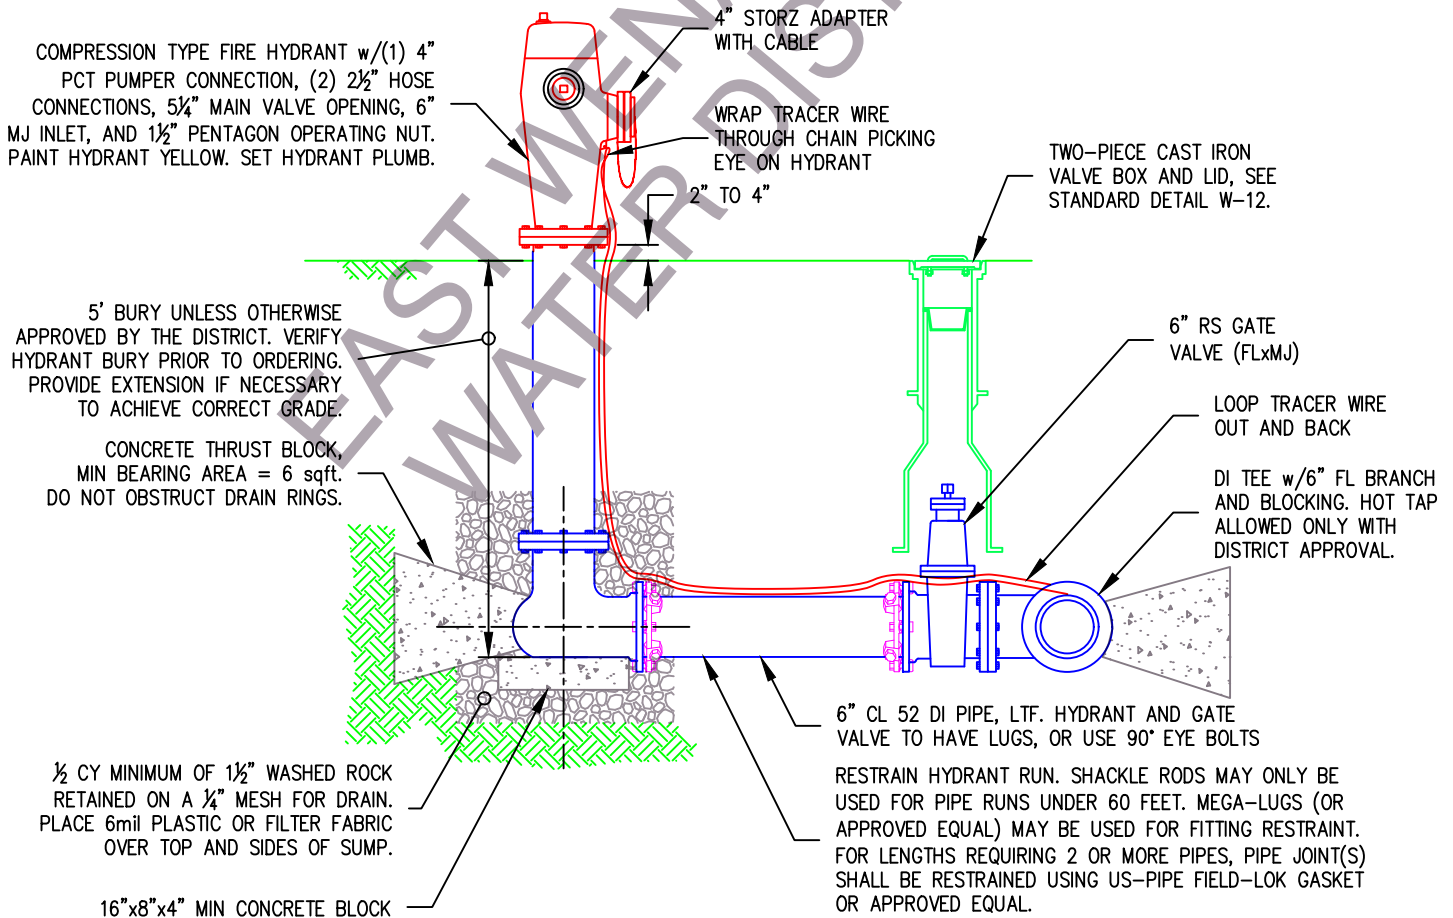


1. SEE STANDARD DETAIL W-23 FOR ADDITIONAL DETAILS INCLUDING LOCATION REQUIREMENTS.
2. ALL HYDRANTS SHALL BE DOUBLE RESTRAINED. WHERE THRUST BLOCKING IS NOT PRACTICAL, SHACKLES AND RESTRAINED JOINTS ARE REQUIRED.
3. APPROVED HYDRANTS:
 - MUELLER A423
 - M & H 129, 129S or 929
 - CLOW MEDALLION
 - WATEROUS WB67-250
 - KENNEDY K81A OR K81D
4. IF THERE IS AN EXISTING HYDRANT IN THE VICINITY THAT WILL BE DEACTIVATED, REMOVE AND DELIVER HYDRANT TO DISTRICT SHOP. CONFIRM WITH DISTRICT AND REFER TO DETAIL W-15 FOR METHODS.
5. COVER HYDRANTS THAT ARE NOT YET IN SERVICE WITH BLACK 3-MIL POLY BAGS.

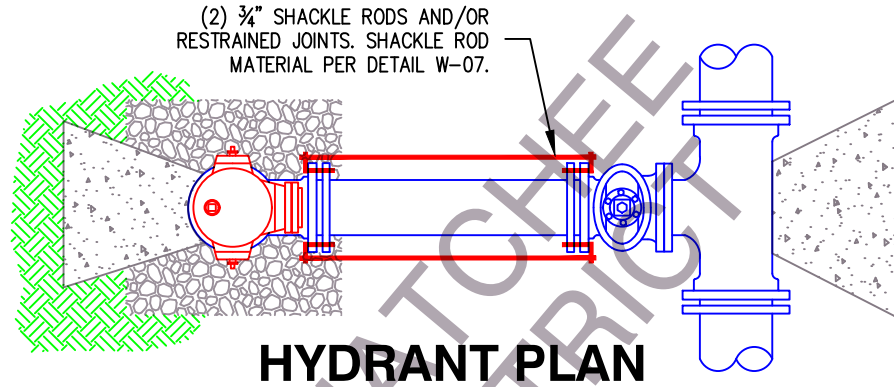

East Wenatchee Water District

WATER SYSTEM STANDARD DETAIL

COPYRIGHT 2025 EAST WENATCHEE WATER DISTRICT. MAY BE REPRODUCED UNMODIFIED FOR DISTRICT PROJECTS. OTHER REPRODUCTION OR USE WITHOUT THE DISTRICT'S WRITTEN CONSENT IS PROHIBITED.

FIRE HYDRANT

FILENAME: EWDTW15

REVISED: OCT 7, 2025

DRAWING No. W-02

SHEET No. 9