



- SEE STANDARD DETAIL W-23 FOR ADDITIONAL DETAILS INCLUDING LOCATION REQUIREMENTS.
- ALL HYDRANTS SHALL BE DOUBLE RESTRAINED. WHERE THRUST BLOCKING IS NOT PRACTICAL, SHACKLES AND RESTRAINED JOINTS ARE REQUIRED.
- APPROVED HYDRANTS:
 - MUELLER A423
 - M & H 129, 129S or 929
 - CLOW MEDALLION
 - WATEROUS WB67-250
 - KENNEDY K81A OR K81D
- IF THERE IS AN EXISTING HYDRANT IN THE VICINITY THAT WILL BE DEACTIVATED, REMOVE AND DELIVER HYDRANT TO DISTRICT SHOP. CONFIRM WITH DISTRICT AND REFER TO DETAIL W-15 FOR METHODS.
- COVER HYDRANTS THAT ARE NOT YET IN SERVICE WITH BLACK 3-MIL POLY BAGS.

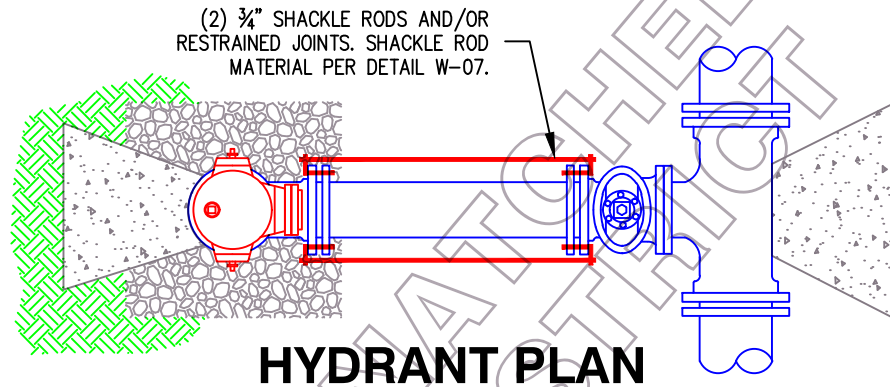

HYDRANT PLAN

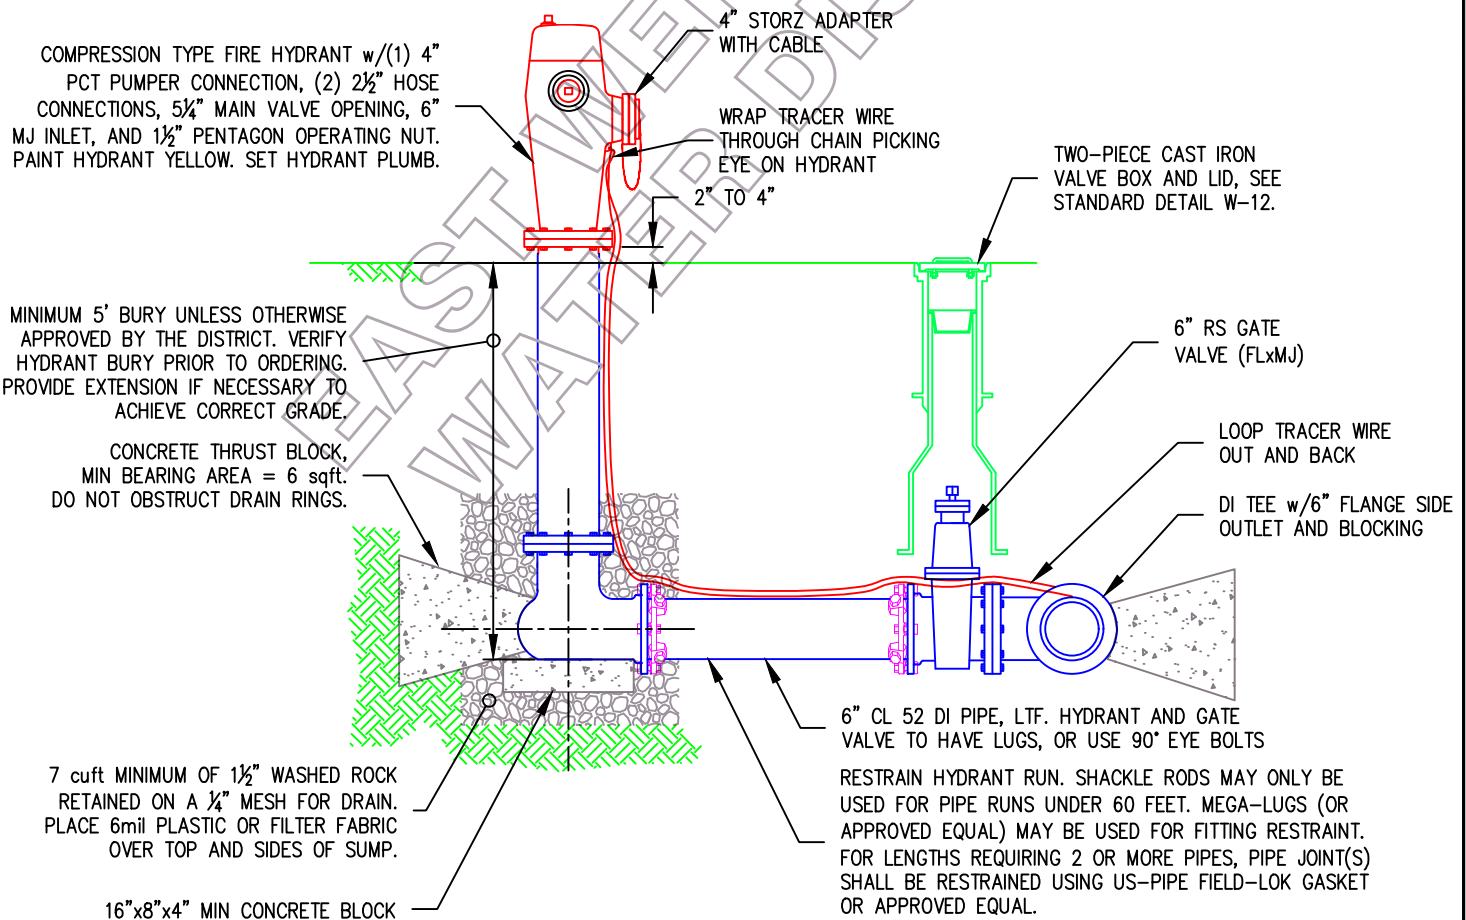

HYDRANT ELEVATION

**East Wenatchee
Water District**



WATER SYSTEM STANDARD DETAIL

FIRE HYDRANT