
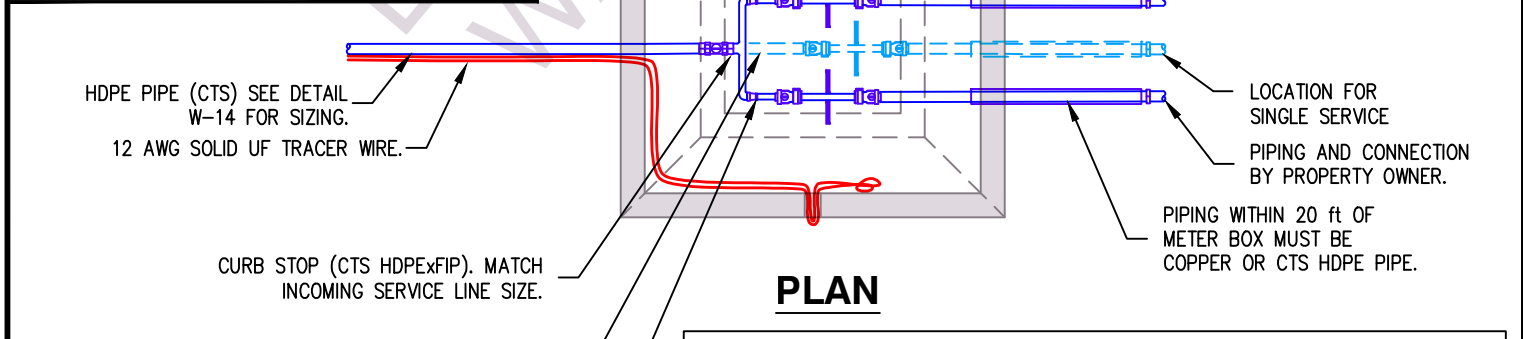


SETTERS

SIZE	FORD	McDONALD	MUELLER
3/8" x 3/4"	VBB73-8W-11-33-7-5-FP-NL	20-D207-JJ-DD-33	5/8" x 3/4" B-2404N
1"	VBB74-10W-11-44-FP-NL	20-412-JJ-DD-44	1x10 B-2404N
	ADAPTERS C84-xx-Q		ADAPTER H-14222

- NOTES:
- SETTER MODEL NUMBERS CHANGE FREQUENTLY. CONFIRM WITH SUPPLIER AND DISTRICT.
 - SETTERS SHALL BE FULL SIZE (FULL-PORT) PIPE, VALVES, AND FITTINGS.
 - 3/8" x 3/4" SETTER: 3/4" I.D. (0.875" O.D.).
 - 1" SETTER: 1" I.D. (1.125" O.D.).
 - 3/4" METER MAXIMUM 20 GPM RATING.
 - 1" METER MAXIMUM 50 GPM RATING.

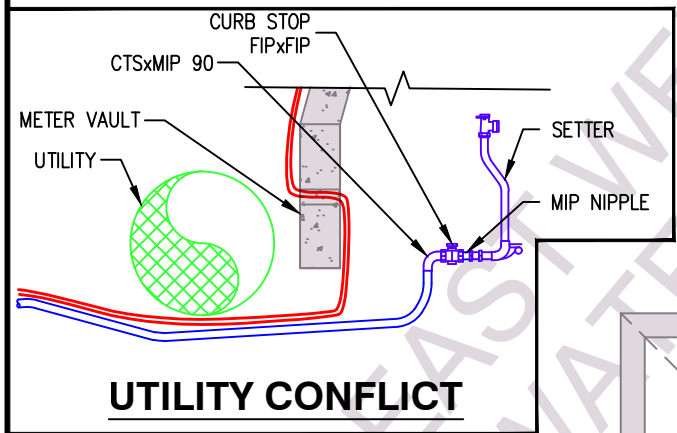

- SINGLE SERVICE FITTINGS
BRASS REDUCING BUSHING FROM CURB STOP SIZE TO SETTER SIZE.
3/4" OR 1" (6" LONG) BRASS NIPPLE.
- DOUBLE SERVICE FITTINGS
1 1/2" x 1" U-BRANCH, FORD U88-64-12
1" x 3/4" BRASS BELL REDUCERS (FOR 3/4" SETTER)
3/4" (2" LONG) BRASS NIPPLES (FOR 3/4" SETTER)

- 1) COMPACT SOIL UNDER AND AROUND VAULT ASSEMBLY TO 90% OF MAXIMUM DENSITY FOR UNTRAVELED AREAS, AND 95% IN ROADS, DRIVES AND SIDEWALKS.
- 2) SEE DRAWING W-29 FOR METER VAULT INSTALLATION DETAILS.
- 3) PRESSURE TEST ENTIRE SERVICE THROUGH SETTER AND TAILPIPE AT 250 psi. TEMPORARY SETTER JUMPERS AND TAILPIPE CAPS FOR TESTING CAN BE PROVIDED BY THE DISTRICT. RETURN TO DISTRICT AFTER TESTING.



East Wenatchee Water District
WATER SYSTEM STANDARD DETAIL

COPYRIGHT 2025 EAST WENATCHEE WATER DISTRICT. MAY BE REPRODUCED UNMODIFIED FOR DISTRICT PROJECTS. OTHER REPRODUCTION OR USE WITHOUT THE DISTRICT'S WRITTEN CONSENT IS PROHIBITED.

3/4" AND 1" SINGLE AND DOUBLE WATER SERVICES

FILENAME: EWD TW26
REVISED: FEB 10, 2023

DRAWING No. W-21
SHEET No. 18