


WATER SERVICE TAP AND PIPE

- MINIMUM SIZING GUIDELINES**
- 1) SADDLE, CORP STOP, AND SERVICE LINE TO BE THE SAME DIAMETER.
 - 2) 1½" DIAMETER SERVICE LINE FOR ALL ¾" AND 1" SINGLE AND DOUBLE METERS.
 - 3) 2" DIAMETER SERVICE LINE FOR 1½" AND 2" METERS.
 - 4) LARGER SIZES MAY BE REQUIRED DEPENDING ON FIRE SPRINKLER DEMANDS, AVAILABLE PRESSURE, OR LONG PIPE RUNS.

RECONNECT CUSTOMER'S SERVICE LINE WITH FITTINGS AS NECESSARY FROM NEW POLY TO CUSTOMER'S PIPE TYPE.

- GALV IRON: LOCKING COMPRESSION OR THREADED.
- POLY: QUICK JOINT OR EQUAL.
- COPPER: SWEATED OR FLARED.

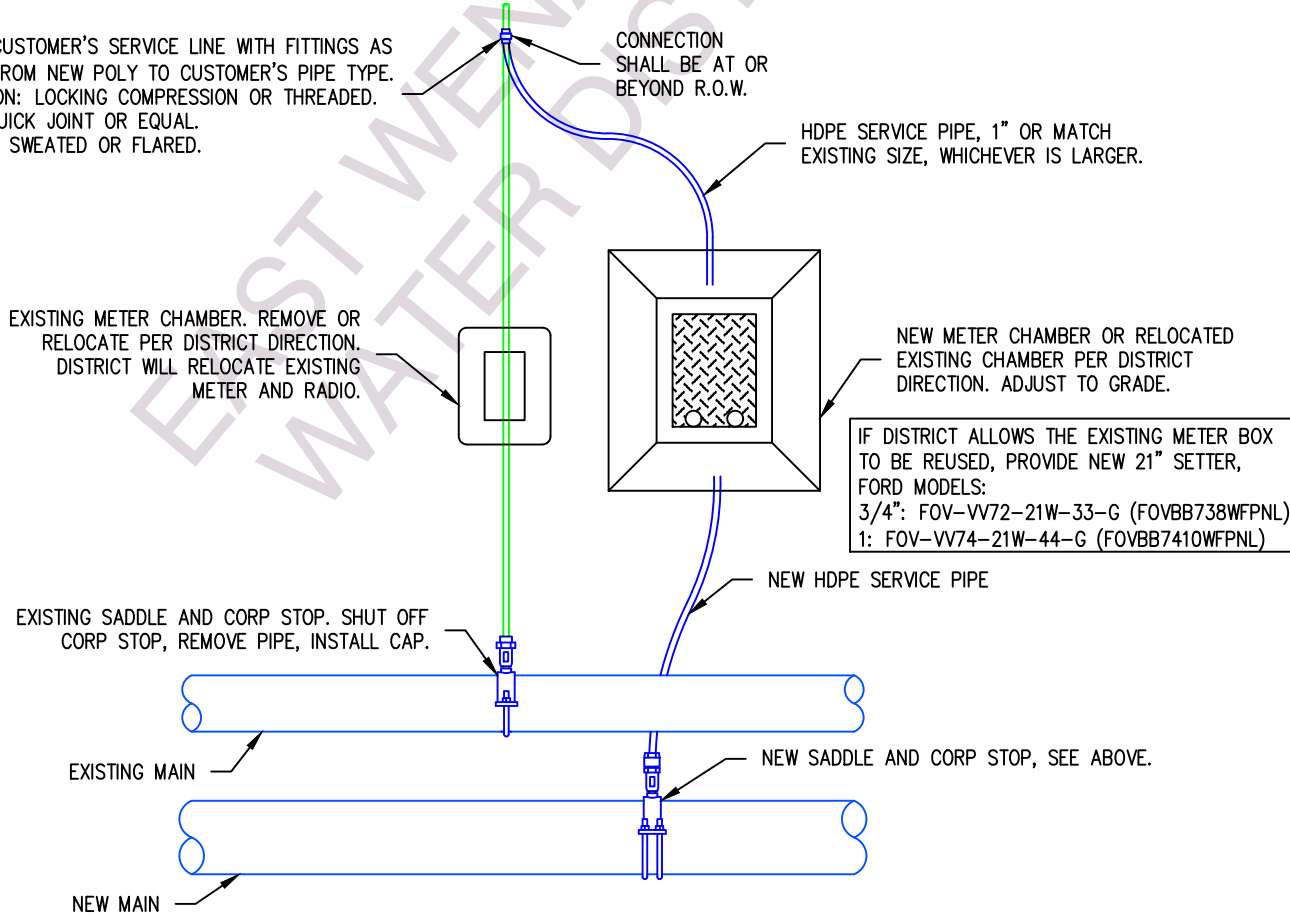

EXISTING SERVICE RECONNECTION



East Wenatchee Water District
WATER SYSTEM STANDARD DETAIL

COPYRIGHT 2025 EAST WENATCHEE WATER DISTRICT. MAY BE REPRODUCED UNMODIFIED FOR DISTRICT PROJECTS. OTHER REPRODUCTION OR USE WITHOUT THE DISTRICT'S WRITTEN CONSENT IS PROHIBITED.

CUSTOMER SERVICE CONNECTIONS

FILENAME: EWDTW14	DRAWING No. W-14
REVISED: MAR 30, 2023	SHEET No. 16