



VERTICAL THRUST BLOCKING FOR 11.25°, 22.5°, AND 45° BENDS							NUMBER OF TIE ROD SETS (2 EMBEDDED RODS PER SET)
PIPE SIZE NOM. DIAMETER - INCHES	TEST PRESSURE PSI	VB VERTICAL BEND DEGREES	AMOUNT CONCRETE BLOCKING - CU FT	S LENGTH OF SIDE FEET	d SHACKLE ROD DIA. INCHES	L DEPTH OF ROD IN CONCRETE INCHES	
3"	300	11 1/4	5.8	1.8	5/8	12"	2
		22 1/2	11.5	2.3	5/8	12"	2
		45	22.6	2.8	5/8	12"	2
4"	300	11 1/4	8.5	2.0	5/8	12"	2
		22 1/2	17.0	2.6	5/8	12"	2
		45	33.2	3.2	5/8	12"	2
6"	300	11 1/4	17.6	2.6	5/8	12"	2
		22 1/2	35.0	3.3	5/8	12"	2
		45	68.7	4.1	5/8	12"	2
8"	300	11 1/4	30.3	3.1	3/4	12"	2
		22 1/2	60.2	3.9	3/4	12"	2
		45	118	4.9	3/4	12"	4
10"	300	11 1/4	45.5	3.6	3/4	12"	2
		22 1/2	90.6	4.5	3/4	12"	2
		45	178	5.6	3/4	24"	4
12"	300	11 1/4	64.4	4.0	3/4	12"	2
		22 1/2	128	5.1	3/4	12"	4
		45	251	6.3	3/4	12"	6
14"	250	11 1/4	86.5	4.4	3/4	12"	2
		22 1/2	172	5.6	3/4	24"	4
		45	338	7.0	1"	24"	6
16"	250	11 1/4	112	4.8	3/4	12"	3
		22 1/2	223	6.1	3/4	12"	6
		45	436	7.6	1"	12"	6
18"	250	11 1/4	141	5.2	3/4	24"	4
		22 1/2	280	6.5	1"	24"	4
		45	549	8.2	1-1/4"	24"	6

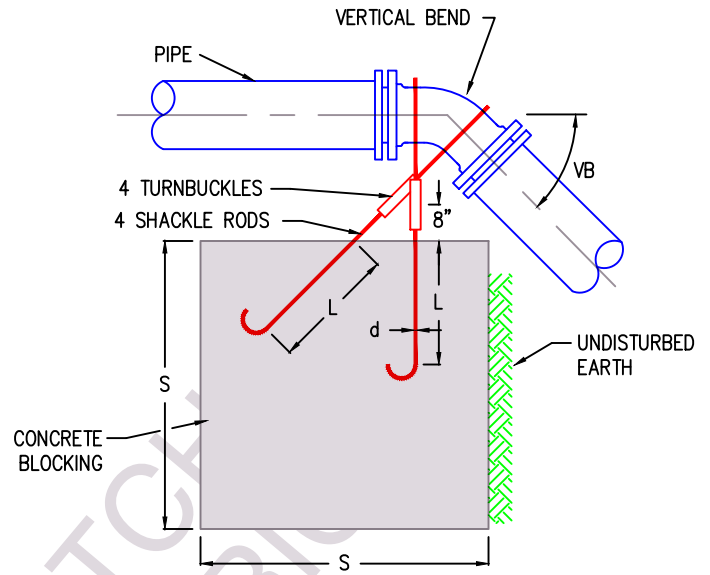

## BLOCKING FOR VERTICAL BENDS

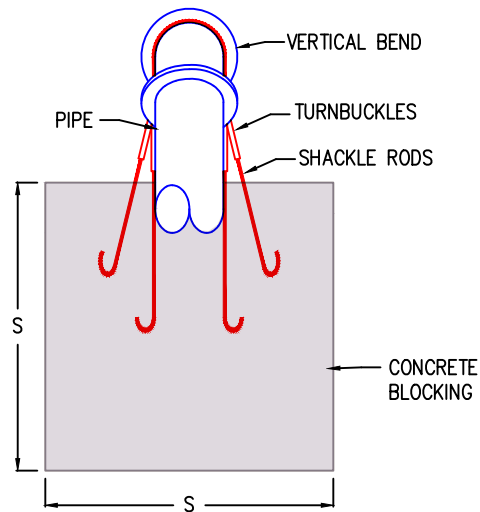

## VERTICAL THRUST BLOCKING

1. RESTRAINED JOINTS ARE PREFERRED OVER VERTICAL THRUST BLOCKING UNLESS RESTRAINTS ARE NOT PRACTICAL.

2. CONCRETE SHALL HAVE A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 3000 PSI.

3. SHACKLE RODS PER STANDARD DETAIL W-07.



## East Wenatchee Water District

WATER SYSTEM STANDARD DETAIL

COPYRIGHT 2025 EAST WENATCHEE WATER DISTRICT. MAY BE REPRODUCED UNMODIFIED FOR DISTRICT PROJECTS. OTHER REPRODUCTION OR USE WITHOUT THE DISTRICT'S WRITTEN CONSENT IS PROHIBITED.

## VERTICAL THRUST BLOCKING

FILENAME: EWD TW13

REVISED: APR 13, 2007

DRAWING No. W-05

SHEET No. 5