


1. CITY OR COUNTY RESTORATION STANDARDS SHALL GOVERN IF MORE STRINGENT THAN SHOWN HERE.
2. PLACE A CRUSHED SURFACING TEMPORARY PATCH OVER TRENCH AT THE END OF EACH WORKING DAY SO THAT TRAFFIC IS NOT AFFECTED.
3. RESTORE INTERSECTIONS AND ROAD CROSSINGS BY THE END OF THE DAY EITHER WITH PERMANENT PATCH OR TEMPORARY COLD MIX.
4. NO TRENCH IN PAVED AREAS SHALL BE LEFT UNPAVED FOR MORE THAN 12 CALENDAR DAYS OR BY THE SECOND FRIDAY, WHICHEVER COMES FIRST.
5. RESTORE DISTURBED SHOULDERS WITH 6" OF CRUSHED SURFACING BASE COURSE.
6. RESTORE DITCHES, CURBS, SIDEWALKS, AND ALL OTHER EXISTING IMPROVEMENTS DISTURBED DURING CONSTRUCTION TO ORIGINAL CONDITION.

IF LESS THAN 3', REMOVE AND REPLACE EXISTING PAVEMENT.
 REPLACE ALL PAVEMENT DAMAGED DURING CONSTRUCTION. CDF MAY BE USED IN UNDERMINED AREAS ONLY WITH DISTRICT AND LOCAL STREET AGENCY APPROVAL.


MINIMUM PAVEMENT RESTORATION REQUIREMENTS

USE ONLY IF PROJECT SPECIFIC RESTORATION DETAILS ARE NOT PROVIDED.

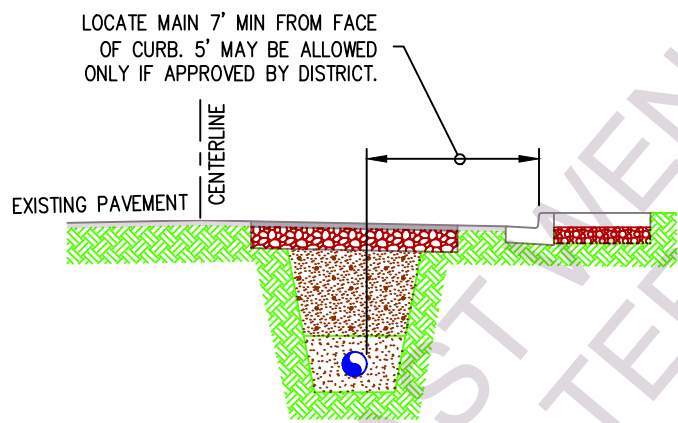


1. INSTALL MAINS TO WITHIN 6-INCHES HORIZONTAL AND 2-INCHES VERTICAL OF THE APPROVED PLAN ALIGNMENT. VARIATIONS MUST BE APPROVED BY THE DISTRICT.
2. RECORD ANY VARIATIONS ON THE AS-BUILT PLANS.

TRENCH IN ROADWAY SECTION

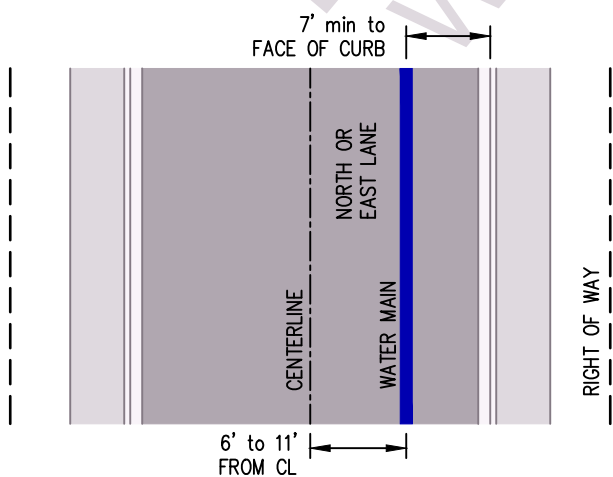

TYPICAL PLAN LOCATION

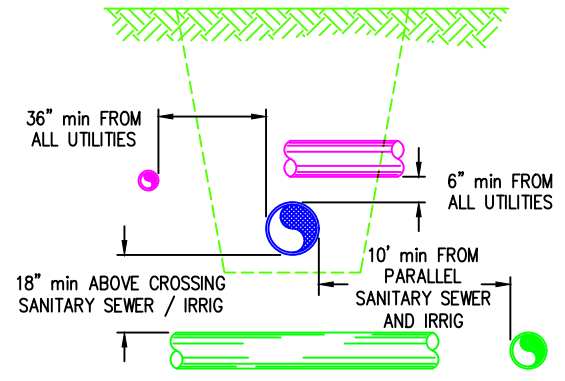

CLEARANCE SECTION

1. IF 18" VERTICAL CLEARANCE IS AVAILABLE ABOVE PARALLEL SEWER/IRRIG, SEPARATION MAY BE REDUCED TO 5 FT HORIZONTAL, WALL TO WALL, BUT ONLY IF APPROVED BY THE DISTRICT.
2. D.O.H. WATER SYSTEM DESIGN MANUAL SECTION 8.4 AND D.O.E. CRITERIA FOR SEWAGE WORKS DESIGN SECTION C1-9 SHALL BE ADHERED TO FOR CLEARANCES AND FOR MITIGATION METHODS.
3. SEE W-32 FOR PIPE CASING DETAIL.



East Wenatchee Water District

WATER SYSTEM STANDARD DETAIL

COPYRIGHT 2025 EAST WENATCHEE WATER DISTRICT. MAY BE REPRODUCED UNMODIFIED FOR DISTRICT PROJECTS. OTHER REPRODUCTION OR USE WITHOUT THE DISTRICT'S WRITTEN CONSENT IS PROHIBITED.

WATER MAIN LOCATION TRENCH RESTORATION

FILENAME: EWD TW34
 REVISED: OCT 7, 2025

DRAWING No. W-34
 SHEET No. 31